
Proposed codal provisions for design and detailing of beam-column joints in seismic regions

Sudhir K. Jain, R.K. Ingle and Goutam Mondal

Beam-column joint is an important part of a reinforced concrete moment resisting frame subjected to earthquake loading. Design and detailing provisions on beam-column joints in IS 13920 : 1993 do not adequately address prevention of anchorage and shear failure in this region during severe earthquake shaking. In view of these limitations, this paper proposes new provisions for inclusion in IS 13920 : 1993. The paper also gives a clause-by-clause commentary on these recommended provisions and includes one solved example to illustrate the same.

Keywords: *Beam-column joints, wide beam, strong-column weak-beam, shear design.*

Beam-column joint is an important component of a reinforced concrete moment resisting frame and should be designed and detailed properly, especially when the frame is subjected to earthquake loading. Failure of beam-column joints during earthquakes is governed by bond and shear failure mechanism which are brittle in nature¹. Therefore, current international codes give high importance to provide adequate anchorage to longitudinal bars and confinement of core concrete in resisting shear². A review of the behaviour and design of different types of beam-column joints in reinforced concrete moment resisting frame under seismic loading illustrates that design and detailing provisions for the joints in the current Indian seismic code, IS 13920 : 1993 are not adequate to ensure prevention of such brittle failure^{3,4,5}. Since joints are subjected to large shear force during earthquake, shear strength in this region should be adequate to carry this large amount of shear force. Therefore, the current code needs to be upgraded to incorporate shear design provisions of beam-column joints. Moreover, under cyclic lateral loading, longitudinal beam bars are subjected to pull out force and

must be provided with sufficient anchorage length within the joint region. For an interior joint this anchorage length can only be provided through adequate column width and depth. Therefore, the code must have a provision for minimum dimension of column. The current code should also include confinement provisions on connection between columns and wide-beams, which are often found in one-way concrete joist systems and in buildings where floor-to-ceiling heights are restricted. This paper presents suggested provisions on beam-column joints for inclusion in IS 13920 : 1993³. These have been developed in line with ACI 318M⁶. The application of the proposed provisions has been illustrated by a solved example for design of an interior joint.

Proposed provisions for beam-column joints

Minimum column size

Clause 1.0

The minimum dimension of column shall not be less than (a) 15 times the largest beam bar diameter of the longitudinal reinforcement in the beam passing through or anchoring into the column joint, and (b) 300 mm.

Commentary 1.0

A small column width may lead to following two problems : (a) the moment capacity of column section is very low since the lever arm between the compression steel and tension steel is very small, and (b) beam bars do not get enough anchorage in the column (both at exterior and interior joints).

Hence, many seismic codes recommend that the dimension of an interior column should not be less than 20 times the diameter of largest beam bar running parallel to

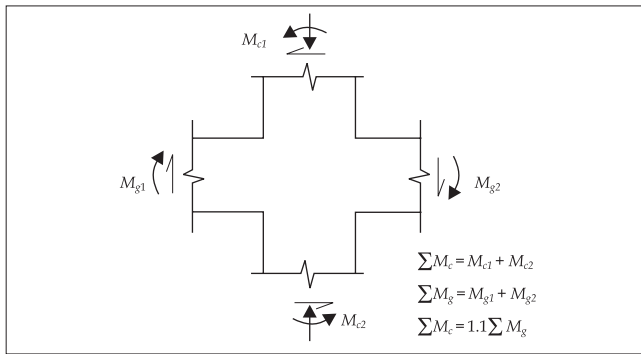


Fig 1 Strong-column-weak-beam concept

that column dimension that is, if beams use 20 mm diameter bars, minimum column width should be 400 mm. The proposed provision for minimum column size has been kept lower than the current international codes keeping in mind the practice in India where much smaller column sections are currently being used than what is common in other seismic countries like USA and New Zealand.

The existing clause no. 7.1.2 of IS 13920 : 1993 specifies the minimum dimension of columns as, "The minimum dimension of the member shall not be less than 200 mm. However, in frames which have beams with centre to centre span exceeding 5 m or columns of unsupported length exceeding 4 m, the shortest dimension of the column shall not be less than 300 mm". It is proposed to revise this clause as per clause 1.0 of this paper .

Longitudinal reinforcement

Clause 1.1

At a joint in a frame, resisting earthquake forces, the sum of the moment of resistance of the columns shall be at least 1.1 times the sum of the moment of resistance of the beams along each principal plane of the joint as shown in Fig 1. The moment of resistance of the column shall be calculated considering the factored axial forces on the column and it should be summed such that the column moments oppose the beam moments. This requirement shall satisfy for beam moments acting in both directions in the principal plane of the joint considered. Columns not satisfying this requirement shall have special confining reinforcement over their full height instead of the critical end regions only.

Commentary 1.1

This clause is based on strong-column-weak-beam theory. It is meant to make the building fail in beam-hinge mechanism (beams yield before the columns do) and not in the storey mechanism (columns yield before the beams). Storey mechanism must be avoided as it causes greater damage to the building. Therefore, column should be stronger than the beams meeting at a joint. ACI 318M requires the sum of the moment of resistance of the columns to be at least 20 percent more than the sum of the moment of resistance of the beams⁶. NZS 3101 : 1995 recommends that the sum of the design flexural strength of columns is at least 40 percent in excess of the overstrength of adjacent beams meeting at the joint⁷.

Transverse reinforcement

Clause 1.2.1

The special confining reinforcement as required at the end of column shall be provided through the joint as well, unless the joint is confined as specified by clause 1.2.3.

Commentary 1.2.1

Quite often joints are not provided with stirrups because of construction difficulties. Similarly, in traditional constructions the bottom beam bars are often not continuous through the joint. Both these practices are not acceptable when the building has to carry lateral loads.

Following are the main concerns regarding joints:

- Serviceability – Diagonal tension cracks should not occur due to joint shear.
- Strength – Should be more than that in the adjacent members.
- Ductility – Not needed for gravity loads, but needed for seismic loads.
- Anchorage – Joint should be able to provide proper anchorage to the longitudinal bars of the beams.
- Ease of construction – Joint should not be congested.

Clause 1.2.2

For a joint, which is confined by structural members as specified by clause 1.2.3, transverse reinforcement equal to at least half the special confining reinforcement required at the end of the column shall be provided within the depth of the shallowest framing member. The spacing of the hoops shall not exceed 150 mm.

Commentary 1.2.2

Transverse reinforcement can be reduced as per 1.2.2 if structural members frame into all four sides of the joints.

Clause 1.2.3

A member that frames into a face is considered to provide confinement to the joint if at least three-quarters of the face of the joint is covered by the framing member. A joint is considered to be confined if such confining members frame into all faces of the joint.

Commentary 1.2.3

A joint can be confined by the beams/slabs around the joint, longitudinal bars (from beams and columns, passing through the joint), and transverse reinforcement.

Wide beam

Clause 1.2.4

If the width of beam exceeds corresponding column dimension, transverse reinforcement as required by clause nos. 7.4.7 and 7.4.8 of IS 13920 : 1993 shall be provided through the joint to provide confinement for longitudinal beam reinforcement outside the column core if such confinement

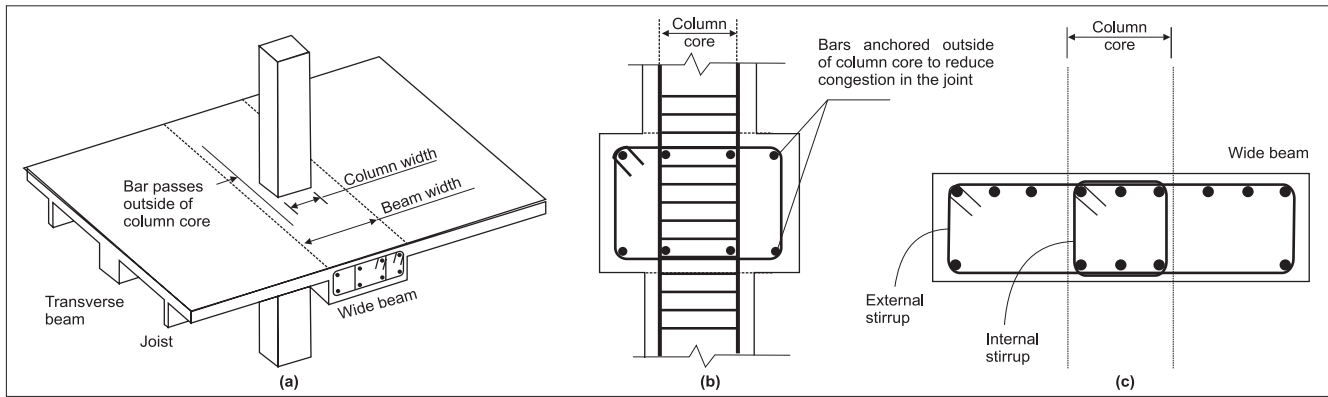


Fig 2 Connection between wide beam and column⁸

is not provided by a beam framing into the joint. In such a case, the value of width of beam b_b should be less than the values of $3b_c$ and $b_c + 1.5h_c$, where b_c and h_c are the column width and depth, respectively.

Commentary 1.2.4

This clause refers to the wide beam, that is, the width of the beam exceeds the corresponding column dimension as shown in Fig 2. In that case, the beam reinforcement not confined by the column reinforcement should be provided lateral support either by a girder framing into the same joint or by transverse reinforcement. The limit of maximum width of wide beam is specified to ensure the formation of beam plastic hinge. The maximum beam width recommended here is based on some experiments on joints between wide beam and column^{9,10,11}. The limit recognises that the effective width of wide beam is closely related to the depth of column than it is to the depth of the wide beam.

Hook

Clause 1.2.5

In the exterior and corner joints, all the 135° hook of the cross-ties should be along the outer face of the column.

Shear design

Shear strength

Clause 1.3.1

The nominal shear strength of the joint shall not be taken greater than $1.5A_{ej}\sqrt{f_{ck}}$ for joints confined on all four faces, $1.2A_{ej}\sqrt{f_{ck}}$ for joints confined on three faces or two opposite faces, and $1.0A_{ej}\sqrt{f_{ck}}$ for others, where, A_{ej} = effective shear area of the joint ($b_j h_j$), b_j = effective width of joint as per clause

1.3.2, h_j = effective depth of joint as per clause 1.3.3, and f_{ck} = characteristic compressive strength of concrete cube in MPa.

Commentary 1.3.1

The concept and values of nominal shear strength specified are in line with ACI 318M- provisions⁶. The nominal shear strength value specified includes the shear carried by the concrete as well as the joint (shear) reinforcement.

Effective width of joint

Clause 1.3.2

The effective width of joint, b_j (Fig 3) shall be obtained based on the following equations:

$$\begin{cases} \text{Min } [b_c; b_b + 0.5h_c] & \text{if } b_c > b_b, \text{ Fig 3(a)} \\ \text{Min } [b_b; b_c + 0.5h_c] & \text{if } b_c < b_b, \text{ Fig 3(b)} \end{cases}$$

where,

b_b = width of beam

b_c = width of column

h_c = depth of column in the considered direction of shear.

Effective depth of joint

Clause 1.3.3

The effective depth of joint h_j can be taken as depth of the column, h_c as shown in Fig 3.

Shear Force

Clause 1.3.4

Shear force in the joint shall be calculated assuming that the stress in flexural tensile reinforcement is $1.25f_y$, where f_y = yield stress of steel.

Commentary 1.3.4

Shear force in the joint due to earthquake load can be calculated as shown in Fig 4. The larger the tension force in the steel, the greater will be the shear in the joint. Hence, the tensile force in the reinforcement is conservatively taken as $1.25f_y A_{st}$, where f_y is the specified yield strength of steel bars

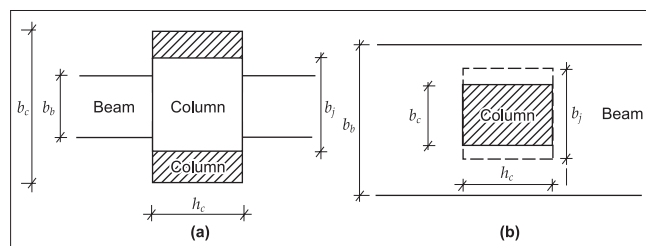


Fig 3 Effective width of joint (plan view)

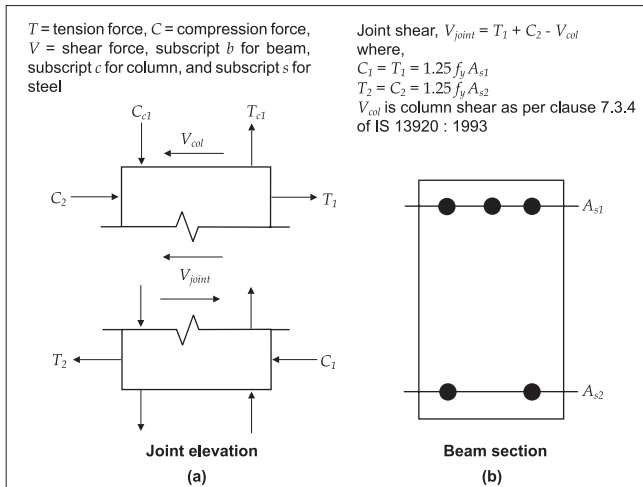


Fig 4 Evaluation of horizontal joint shear¹²

and A_{s1} is cross sectional area of steel bars, for computation of joint shear to account for (a) the actual yield strength of the steel normally being greater than the specified yield strength f_y , and (b) the effect of strain hardening at high strain. Some experiments conducted in the structural engineering laboratory at IIT Kanpur on Indian high yield strength deformed (HYSD) (Fe415) steel bars found the actual yield strength (≈ 440 MPa) to be higher than the specified yield strength (415 MPa) and the ultimate stress of HYSD bars was found as $\approx 1.27 f_y$.⁽¹³⁾

Solved example

The detailed design of an interior joint in an intermediate RC moment resisting frame is explained here as per the above mentioned provisions. The structure is a ground plus four storey office building situated in Zone V. Examples on other different types of joints are available on the website, <http://www.iitk.ac.in/nicee/IITK-GSDMA/EQ22.pdf>.

Design data

The joint of column marked in Fig 5 is considered for design. The plan and sectional elevation of the building are shown in Figs 5 and 6. The details of the column and beam reinforcement meeting at the joint are shown in Fig 7. The transverse beam of size 300 mm \times 600 mm is reinforced with

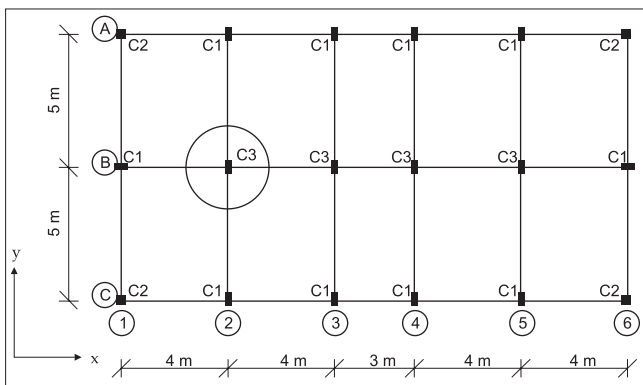


Fig 5 Plan of a ground plus four storey reinforced concrete office building

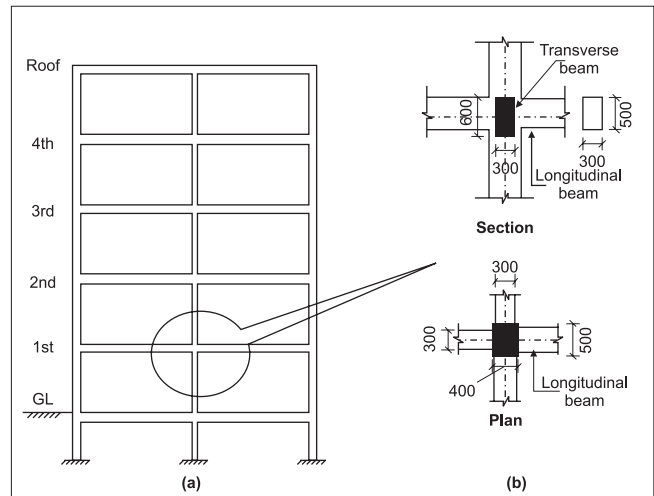


Fig 6 (a) Joint location in elevation of the building, (b) Details of the connected members in the joint

5 ϕ 20 + 4 ϕ 16 (2374 mm², that is, 1.44 percent) at top and 5 ϕ 16 + 1 ϕ 20 (1320 mm², that is., 0.80 percent) at bottom. The hogging and sagging moment capacities of the transverse beams are evaluated as 377 kN-m and 246 kN-m, respectively. The longitudinal beam of size 300 mm \times 500 mm is reinforced with 4 ϕ 20 + 5 ϕ 16 (2260 mm², that is, 1.67 percent) at top and 3 ϕ 20 + 4 ϕ 16 (1746 mm², that is, 1.29 percent) at bottom. The hogging and sagging moment capacities of the longitudinal beams are evaluated as 288 kN-m and 221 kN-m, respectively.

Minimum column size

Minimum size of column

$$= \text{maximum of } \begin{cases} 15 \times 20 \text{ mm} \\ 300 \text{ mm} \end{cases}$$

$$= 300 \text{ mm} < \text{width of column} = 400 \text{ mm.}$$

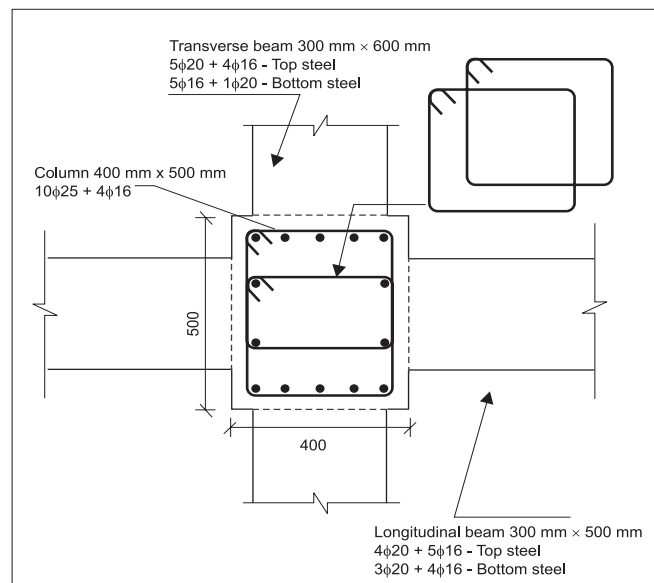


Fig 7 Reinforcement details for beams and column

Hence, the values are acceptable as per clause 1.0

Check for earthquake in y direction

Column shear

The column shears for sway to right and left is shown in Fig 8. For both the cases,

$$V_{col} = 1.4 \left(\frac{M_s + M_h}{h_{st}} \right)$$

$$= 1.4 \left(\frac{377 + 246}{3} \right)$$

$$= 291 \text{ kN}$$

Joint shear

The development of forces in the joint for sway to right and left is shown in Fig 9.

Force developed in the top bars

$$T_1 = 1.25 f_y A_{st} = 1.25 \times 415 \times 2374 / 1000 = 1232 \text{ kN} = C_1$$

The factor 1.25 is to account for the actual ultimate strength being higher than the actual yield strength as per clause 1.3.4

Force developed in the bottom bars

$$T_2 = 1.25 f_y A_{st} = 1.25 \times 415 \times 1320 / 1000 = 685 \text{ kN} = C_2$$

Referring to clause 1.3.4

Joint Shear, $V_{joint} = T_1 + C_2 - V_{col} = 1232 + 685 - 291 = 1626 \text{ kN}$

Maximum value of T_1 and minimum value of V_{col} are used in the above equation.

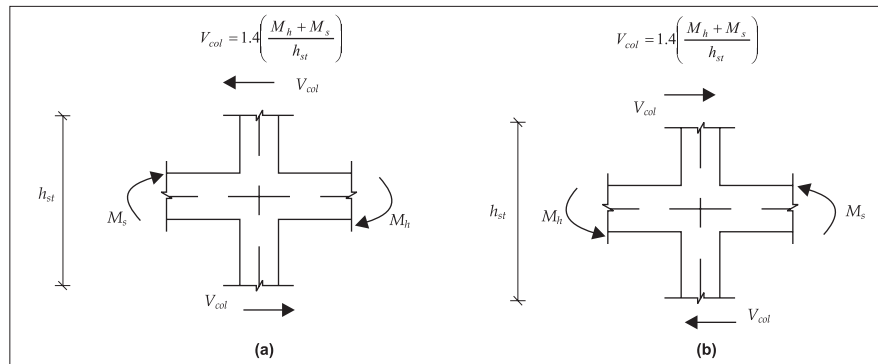


Fig 8 Column shear (a) Sway to right (b) Sway to left

Check for joint shear strength

The effective width provisions for joints are shown in Fig 3. As per clause 1.3.2 the effective width of the joint is lesser of the following two values:

$$(i) b_j = b_b + 0.5 \times h_c$$

$$(ii) b_j = b_c$$

$$b_j = b_b + 0.5 \times h_c = 300 + 0.5 \times 500 = 550 \text{ mm, or}$$

$$b_j = b_c = 400 \text{ mm}$$

Therefore, effective width of joint, $b_j = 400 \text{ mm}$.

$$h_j = \text{depth of the column} = 500 \text{ mm}$$

$$\text{Effective shear area of the joint} = A_{ej} = b_j h_j$$

The joint is confined on two opposite faces as per clause 1.2.3,

$$\begin{aligned} \text{Shear strength} &= 1.2 A_{ej} \sqrt{f_{ck}} \\ &= 1.2 \times (400 \times 500 / 1000) \times \sqrt{20} \\ &= 1070 \text{ kN} < 1626 \text{ kN}. \end{aligned}$$

Hence, the values are unsafe as per clause 1.3.1

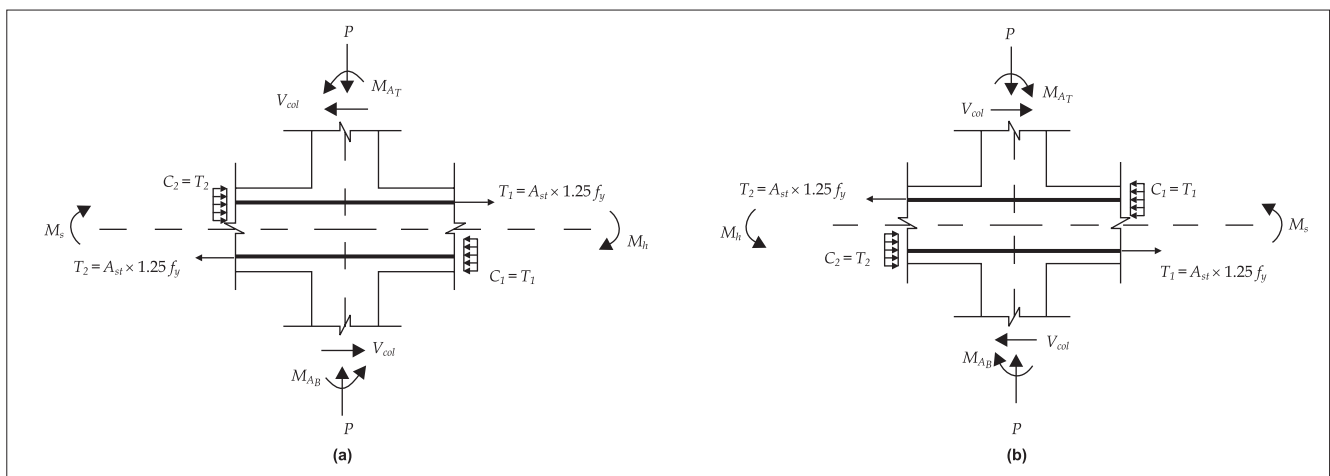


Fig 9 Free body diagram of the joint (a) Sway to right, (b) Sway to left

Check for flexural strength ratio

The hogging and sagging moment capacities of the transverse beams are 377 kN-m and 246 kN-m, respectively.

The column is reinforced with $10\phi 25 + 4\phi 16$ bars (5714 mm^2 , that is, 2.85 percent). Hence, $p/f_{ck} = 2.85/20 = 0.14$

It is conservative here to calculate the moment capacity of column with zero axial loads for lower values of $\frac{P_u}{f_{ck}bD}$. In actual practice, it is desirable to take minimum $\frac{M_u}{f_{ck}bD^2}$ corresponding to actual $\frac{P_u}{f_{ck}bD}$ obtained from different load combinations. It may be noted that for higher values of $\frac{P_u}{f_{ck}bD}$ the corresponding values of $\frac{M_u}{f_{ck}bD^2}$ will be less and hence the value corresponding to $\frac{P_u}{f_{ck}bD} = 0.00$ is to be considered. As per chart 44 of SP 16 : 1980, corresponding to $\frac{P_u}{f_{ck}bD} = 0.00$ for $p/f_{ck} = 0.14$ and $d'/D = (40 + 25 / 2) / 500 = 0.11$, we get¹⁴,

$$\frac{M_u}{f_{ck}bD^2} = 0.19$$

$$M_u = (0.19 \times 20 \times 400 \times 500^2) / 10^6 = 380 \text{ kN-m}$$

The joint is checked for strong-column-weak-beam as per clause 1.1.

$$\sum M_c = 380 + 380 = 760 \text{ kN-m}$$

$$\sum M_g = 377 + 246 = 623 \text{ kN-m}$$

$$\text{The ratio of } \frac{\sum M_c}{\sum M_g} = 760 / 623 = 1.2 > 1.1$$

Hence, requirement of strong-column-weak-beam condition is satisfied as per clause 1.1.

Check for earthquake in x direction

Column shear

The column shears for sway to right and left are shown in Fig 8. For both the cases,

$$V_{col} = 1.4 \left(\frac{M_s + M_h}{h_{st}} \right) = 1.4 \left(\frac{288 + 221}{3} \right) = 238 \text{ kN}$$

Joint shear

The development of forces in the joint for sway to right and left is shown in Fig 9.

Force developed in the top bars

$$T_1 = 1.25 f_y A_{st} = 1.25 \times 415 \times 2260 / 1000 = 1170 \text{ kN} = C_1$$

Force developed in the bottom bars

$$T_2 = 1.25 f_y A_{st} = 1.25 \times 415 \times 1746 / 1000 = 905 \text{ kN} = C_2$$

The joint shear is evaluated as per clause 1.3.4 considering maximum T_1 and minimum V_{col} .

$$V_{joint} = T_1 + C_2 - V_{col} = 1170 + 905 - 238 = 1837 \text{ kN}$$

Check for joint shear strength

The effective width provisions for joints are shown in Fig 3. As per clause 1.3.2, the effective width of the joint is lesser of the following two values:

$$(i) b_j = b_b + 0.5 \times h_c = 300 + 0.5 \times 400 = 500 \text{ mm, or}$$

$$(ii) b_j = b_c = 500 \text{ mm}$$

Adopt lesser of the two values,

$$b_j = 500 \text{ mm}$$

$$h_j = \text{depth of the column} = 400 \text{ mm}$$

$$\text{Effective shear area of the joint} = A_{ej} = b_j h_j$$

The joint is not confined as per clause 1.2.3

$$\begin{aligned} \text{Shear strength} &= 1.0 A_{ej} \sqrt{f_{ck}} \\ &= 1.0 \times (500 \times 400 / 1000) \times \sqrt{20} \\ &= 894 \text{ kN} < 1837 \text{ kN} \end{aligned}$$

Hence, the values are unsafe as per clause 1.3.1

Check for flexural strength ratio

The limiting hogging and sagging moment capacities of the longitudinal beam are 288 kN-m and 221 kN-m, respectively. It is conservative here to calculate moment capacity of column

with zero axial loads for lower values of $\frac{P_u}{f_{ck}bD}$. In actual practice, it is desirable to take minimum $\frac{M_u}{f_{ck}bD^2}$ corresponding

to actual $\frac{P_u}{f_{ck}bD}$ obtained from different load combinations. It

may be noted that for higher values of $\frac{P_u}{f_{ck}bD}$ the

corresponding values of $\frac{M_u}{f_{ck}bD^2}$ will be less and hence the

value corresponding to $\frac{P_u}{f_{ck}bD} = 0.00$ is to be considered. As

per chart 44 of SP 16 : 1980, corresponding to $\frac{P_u}{f_{ck}bD} = 0.00$,

for $p/f_{ck} = 0.14$ and $d'/D = (40 + 25 / 2) / 400 = 0.13$, we get¹⁴,

$$\frac{M_u}{f_{ck}bD^2} = 0.178$$

$$M_u = (0.178 \times 20 \times 500 \times 400^2) / 10^6 = 284 \text{ kN-m}$$

The joint is checked for strong-column-weak-beam as per clause 1.1

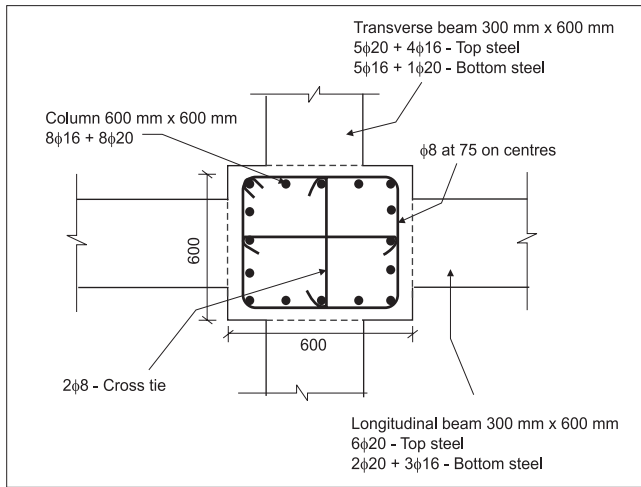


Fig 10 Revised reinforcement details for column and beams

$$\Sigma M_c = 284 + 284 = 568 \text{ kN-m}$$

$$\Sigma M_g = 288 + 221 = 509 \text{ kN-m}$$

$$\text{The ratio of } \frac{\Sigma M_c}{\Sigma M_g} = 568/509 = 1.12 > 1.1.$$

Hence, requirement of strong-column-weak-beam condition is satisfied as per clause 1.1

Revision

As can be seen from the checks in the above section, the joint is not safe in shear. In such cases, the following three alternatives can be tried.

(i) Increase of column section

This option will not only increase the area of joint but also reduce the requirement of main longitudinal steel bars in the column owing to larger column size.

(ii) Increase of size of the beam section

If this option is adopted, it is advisable to increase the depth of the beam. This will reduce the steel required in the beam and hence will reduce the joint shear. In case of depth restriction in the beam, increase in beam width can be considered if the difference between the shear strength of joint and joint shear is small.

(iii) Increase of grade of concrete

This option will increase the shear strength of joint and also reduce the steel required in columns.

It is proposed to increase column size from 400 mm x 500 mm to 600 mm x 600 mm and longitudinal beam size from 300 mm x 500 mm to 300 mm x 600 mm. Member forces are taken as calculated earlier without reanalysis of the structure. In practice, the structure may be reanalysed.

The redesigned longitudinal beam of size 300 mm x 600 mm is reinforced with 6φ20 (1884 mm², that is, 1.14 percent) at top and 2φ20 + 3φ16 (1230 mm², that is, 0.74 percent) at

bottom. The hogging and sagging moment capacities are evaluated as 293 kN-m and 229 kN-m, respectively.

The ΣM_c required in transverse direction is $623 \times 1.1 = 685 \text{ kN-m}$ and $522 \times 1.1 = 574 \text{ kN-m}$ in longitudinal direction.

Hence, required moment capacity for column is $M_c = 685 / 2 = 343 \text{ kN-m}$ in y direction and $574 / 2 = 287 \text{ kN-m}$ in x direction as per clause 1.1.

It is found that 1.1 percent steel is required to satisfy the above moment capacity of column (SP 16 : 1980¹⁴). Hence, change of the main longitudinal steel bars to 8φ20 + 8φ16 (4120 mm², that is 1.14 percent steel) is to be used. The revised reinforcement details are shown in Fig 10. This column section will satisfy the flexural strength check.

While redesigning the column, some of the load combinations may give an axial stress less than $0.1 f_{ck}$. The section needs to be checked for flexure for these load combinations.

Minimum column size

Minimum size of column

$$= \text{maximum of } \begin{cases} 15 \times 25 \text{ mm} \\ 300 \text{ mm} \end{cases}$$

$$= 300 \text{ mm} < \text{width of column} = 600 \text{ mm}.$$

Hence, the values are acceptable as per clause 1.0

Check for earthquake in y direction

$$b_j = b_b + 0.5 \times h_c = 300 + 0.5 \times 600 = 600 \text{ mm}$$

$$\text{or, } b_j = b_c = 600 \text{ mm}$$

Adopt lesser of the two values,

$$b_j = 600 \text{ mm}$$

$$h_j = \text{depth of column} = 600 \text{ mm}$$

$$\begin{aligned} \text{Shear strength} &= 1.0 A_{ej} \sqrt{f_{ck}} \\ &= 1.0 \times (600 \times 600 / 1000) \times \sqrt{20} \\ &= 1610 \text{ kN} < 1620 \text{ kN}. \end{aligned}$$

Here, shear strength value of 1610 kN is less than shear stress developed at the joint (1620 kN). Hence, one should re-design the joint dimensions because it is unsafe as per clause 1.3.1. But, since the difference is only 0.6 percent, this is ignored in the present case.

Check for earthquake in x direction

Referring to Fig 8, for both the cases, shear due to formation of plastic hinges in beams is,

$$V_{col} = 1.4 \left(\frac{M_s + M_t}{h_{st}} \right) = 1.4 \left(\frac{293 + 229}{3} \right) = 244 \text{ kN}$$

Referring to Fig 9, we get,

$$T_1 = 1.25 f_y A_{st} = 1.25 \times 415 \times 1884 / 1000 = 978 \text{ kN} = C_1$$

$$T_2 = 1.25 f_y A_{st} = 1.25 \times 415 \times 1230 / 1000 = 638 \text{ kN} = C_2$$

The joint shear is evaluated considering maximum T_1 and minimum V_{col} .

$$V_{joint} = T_1 + C_2 - V_{col} = 978 + 638 - 244 = 1370 \text{ kN}$$

$$b_j = b_b + 0.5 \times h_c = 300 + 0.5 \times 600 = 600 \text{ mm}$$

or, $b_j = b_c = 600 \text{ mm}$

Adopt lesser of the two values,

$$b_j = 600 \text{ mm}$$

$$h_j = \text{depth of column} = 600 \text{ mm}$$

$$\begin{aligned} \text{Shear strength} &= 1.0 A_{ej} \sqrt{f_{ck}} \\ &= 1.0 \times (600 \times 600 / 1000) \times \sqrt{20} \\ &= 1610 \text{ kN} > 1370 \text{ kN}. \end{aligned}$$

Hence, the values are safe as per clause 1.3.1

Confining links

In this case with the column dimensions revised to 600 mm \times 600 mm, the width of beam is 300 mm, which is less than 3/4 width of column, that is, $3/4 \times 600 = 450 \text{ mm}$. Hence, full confining reinforcement is required in the joint as per clause 1.2.1.

The spacing of links for the confining zone shall not exceed:

(i) $1/4$ of minimum column dimension, that is, $600 / 4 = 150 \text{ mm}$

(ii) But should not be less than 75 mm nor more than 100 mm (clause 7.4.6 of IS 13920 : 1993³)

The area of cross section A_{sh} of the bar forming rectangular hoop to be used as special confining reinforcement shall not be less than

$$A_{sh} = \frac{0.18 \times S \times h \times f_{ck}}{f_y} \left(\frac{A_g}{A_k} - 1 \right) \quad (\text{clause 7.4.8 of IS 13920 : 1993}^3)$$

Assuming, nominal cover of 40 mm to the longitudinal reinforcement, the area of concrete core, $A_k = (600 - 2 \times 40) \times (600 - 2 \times 40) = 27 \times 10^4 \text{ mm}^2$

$$A_g = \text{gross area of the column cross section} = 600 \times 600 = 36 \times 10^4 \text{ mm}^2$$

h = longer dimension of the rectangular confining hoop measured at its outer face

$$= (600 - 40 \times 2) = 520 \text{ mm} > 300 \text{ mm}$$

Hence, a single cross tie in both the directions will have to be provided. Thus,

$$h = 520/2 = 260 \text{ mm} < 300 \text{ mm}.$$

Assuming, rectangular hoops of diameter 8 mm, $A_{sh} = 50 \text{ mm}^2$,

$$50 = \frac{0.18 \times S \times 260 \times 20}{415} \left(\frac{36 \times 10^4}{27 \times 10^4} - 1 \right)$$

$$S = \text{spacing of hoops} = 65 \text{ mm} < 75 \text{ mm}$$

Provide $\phi 8 \text{ mm}$ confining links at 75 mm on centres in the joint.

Conclusion

Beam-column joints in moment resisting frames have traditionally been neglected in design process while the individual connected elements, that is, beams and columns, have received considerable attention in design. Research on beam-column joints of reinforcement concrete moment resisting frame was started only in the 1970s. The 1993 version of IS 13920 : 1993 incorporated some provisions on the design of beam-column joints³. However, these provisions are inadequate to prevent shear and bond failure of beam-column joints in severe seismic shaking. Therefore, these provisions need to be upgraded substantially with inclusion of explicit provisions on shear design and anchorage requirements. This article proposes provisions for shear design of beam-column joint and anchorage requirements of tension beam bars in the joint area. It also suggests provisions for the confinement of wide beam and column connections. A solved design example has been provided to illustrate these provisions for an interior beam-column joint. In the solved example it was seen that the joint fails in shear for design earthquake shaking in both x and y directions. The joint can be redesigned by increasing size of column, size of beam, or grade of concrete. In this example, however, the increase of size of column and depth of beam are sufficient to satisfy the shear strength requirements.

Acknowledgement

This work has been supported through a project entitled, 'Review of Building Codes and Preparation of Commentary and Handbooks,' awarded to IIT Kanpur by Gujarat State Disaster Management Authority (GSDMA), Gandhinagar through World Bank funding. The views and opinions expressed here are those of the authors and do not necessarily reflect those of GSDMA or the World Bank. The authors are grateful to Dr S.R. Uma of University of Canterbury and Dr Bhupinder Singh of IIT Roorkee for critical review of the solved examples.

References

1. PAULAY, T. and PRIESTLEY, M.J.N., *Seismic Design of Reinforced Concrete and Masonry Buildings*, John Wiley and Sons, 1992.
2. UMA, S.R. and JAIN, S.K., Seismic design of beam-column joints in RC moment resisting frames – review of codes, *Structural Engineering and Mechanics*, 2006, Vol. 23, No. 5, pp. 579-597.
3. _____ *Indian standard code of practice for ductile detailing of reinforced concrete structures subjected to seismic forces*, IS 13920 : 1993, Bureau of Indian Standards, New Delhi, November 2003.
4. UMA, S.R. and PRASAD, A.M., Seismic behaviour of beam column joints in RC moment resisting frame - A review, *The Indian Concrete Journal*, January 2006, Vol. 80, No.1, pp. 33-42

5. SUBRAMANIAN, N. and RAO, D.S.P., Seismic design of joints in RC structures, – A review, *The Indian Concrete Journal*, February 2003, Vol. 77, No. 2, pp. 883-892.
6. _____ *Building code requirements for reinforced concrete and commentary*, ACI 318M, American Concrete Institute, 2005.
7. _____ *Concrete structures standards- Part 1: The design of concrete structures*, NZS 3101(Part 1): 1995, Standards Council, New Zealand.
8. GENTRY, T.R. and WIGHT, J.K., *Reinforced Concrete Wide Beam-Column Connections under Earthquake Type Loading.*, Report no. UMCEE 92-12, Department of Civil and Environmental Engineering, The University of Michigan, Ann Arbor, Michigan, USA, June 1992.
9. GENTRY, T.R. and WIGHT, J.K., Wide beam-column connections under earthquake-type loading, *Earthquake Spectra*, Vol. 10, No. 4, November 1994, pp. 675-703.
10. HATAMOTO, H., BESSHO, S. and MATSUZAKI, Y., Reinforced Concrete Wide Beam-to-Column Subassemblages Subjected to Lateral Load, *Design of Beam-Column Joints for Seismic Resistance*, SP-123, American Concrete Institute, Michigan, USA, pp. 291-316.
11. LAFAYE, J.M. and WIGHT, J.K., Experimental Comparison of Reinforced Concrete Wide Beam Connections and Conventional Connections Subjected to Lateral Loading, *Proceedings of the Sixth US National Conference on Earthquake Engineering: Seismic Design and Mitigation for the Third Millennium*, Earthquake Engineering Research Institute, California, USA, 1998.
12. _____ *Recommendations for design of beam-column joints in monolithic reinforced concrete structures*, ACI 352, American Concrete Institute, 1989.
13. DASGUPTA, P., *Effect of Confinement on Strength and Ductility of Large RC Hollow Sections*, Master of Technology Thesis, Department of Civil Engineering, Indian Institute of Technology Kanpur, Kanpur, 2000.
14. _____ *Design aids for reinforced concrete to IS 456 : 1978*, SP 16:1980, Bureau of Indian Standards, New Delhi, September 1980.




Dr Sudhir K. Jain is currently professor in the department of civil engineering at the Indian Institute of Technology Kanpur. His areas of interest include earthquake-resistant design, seismic design codes, and dynamics of buildings with flexible floor diaphragms. He is the co-ordinator of the National Information Centre of Earthquake Engineering (NICEE) hosted at IIT Kanpur (www.nicee.org). Dr Jain is the national co-ordinator of National Programme on Earthquake Engineering Education (www.nicee.org/npeee). He is a director of the International Association for Earthquake Engineering, and of the World Seismic Safety Initiative.



Dr R. K. Ingle is currently professor in the department of applied mechanics at Visvesvaraya National Institute of Technology, Nagpur. His areas of interest include structural analysis and design of buildings, bridges and water tanks.



Mr Goutam Mondal obtained M. Tech in civil engineering from the Indian Institute of Technology Kanpur, and is currently pursuing doctoral studies at the same institute. His areas of interest include earthquake-resistant design and analysis of masonry infilled RC buildings.

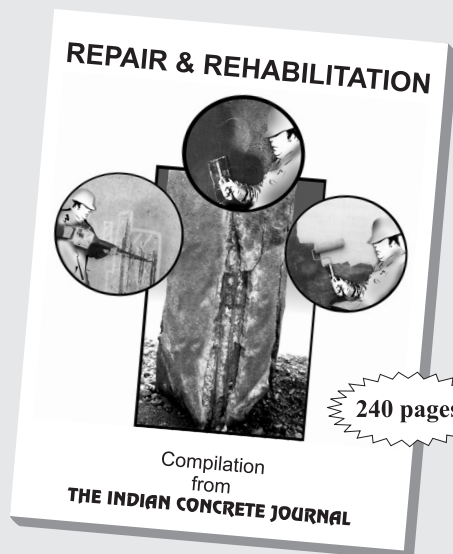

- ☉ Everything you want to know in repair and rehabilitation
- ☉ 45 selected papers published in ICJ during the recent past
- ☉ Indian case studies from those who were associated
- ☉ Contributions from world-renowned experts like P. Emmons, D. Kaminetzky, Dr G.M. Sabnis, A. Vaysburd, N.P. Mailvaganam, etc.

Price: Rs. 500/-

Please send the remittance in favour of "The Associated Cement Cos. Ltd".

Cheques will be accepted only for Mumbai (including Navi Mumbai and Thane). For those outside Mumbai, kindly add Rs 100 to the cheque amount. Otherwise, kindly send either a cheque payable at par in Mumbai or a DD

Contact: The Circulation Manager, The Indian Concrete Journal, ACC Limited, CRS Complex, L.B. Shastri Marg, Thane 400 604. *Tel:* (022) 25825333 (direct), 2582 3631, Ext 653; *Fax:* (022) 2582 0962; *E-mail:* info@icjonline.com *Website:* www.icjonline.com